


NOTE:

1. All new curb boxes must have riser rods. When an existing curb box is on a construction or reconstruction project, riser rods shall be installed in all curb boxes on that project.
2. Placement of curb stop and box on private streets shall be 10' back of curb with no copper stubbed past the curb stop and box.
3. A "W" stamp per City Plate No. STR-28 must be placed on the face of curb wherever a water service crosses the curb and gutter.

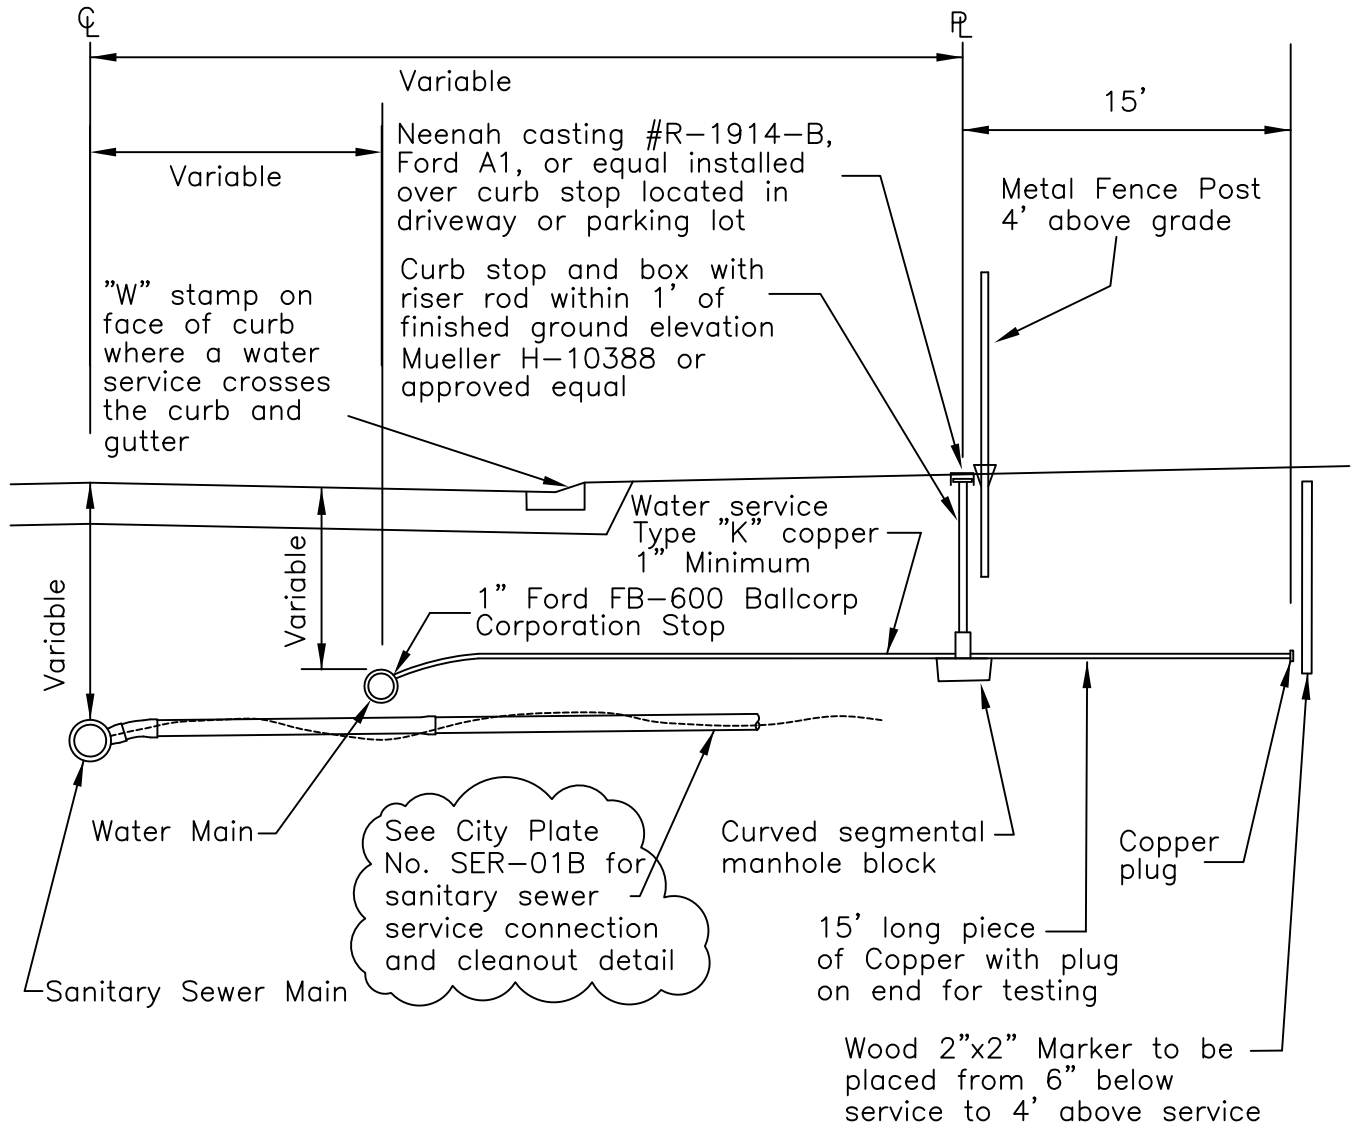

STANDARD DETAILS  
WATER SERVICE CONNECTION

FARMINGTON, MINNESOTA

Last Revision:  
FEB 2017

City Plate No.  
SER-01A  
2017